



# SCHELV1 SGK301

SUBSTATION FANLESS COMPUTER



**IEC 61850-3 Test**

**Revision Date: Aug. 2<sup>nd</sup> 2021**



## **EC-Declaration of Conformity**

For the following equipment:

Substation Fanless Computer

---

( Product Name )

SCH-3X1 / PERFECTRON CO.,LTD.

---

( Model Designation / Brand Name )

PERFECTRON CO.,LTD. TAIWAN BRANCH

---

( Manufacturer Name )

2F., No.190, Sec. 2, Zhongxing Rd., Xindian Dist., New Taipei City 231, Taiwan (R.O.C.)

---

( Manufacturer Address )

is here with confirmed to comply with the requirements set out in the Council Directive on the Approximation of the Laws of the Member States relating to Electromagnetic Compatibility Directive (2014/30/EU). For the evaluation regarding the Electromagnetic Compatibility (2014/30/EU), the following standards are applied:

EN 55032: 2015 / A11: 2020

CISPR 32: 2015 (Ed 2.0) / C1: 2016

EN IEC 61000-3-2: 2019

EN 61000-3-3: 2013

EN 55035: 2017 / A11: 2020

IEC 61000-4-2: 2008; IEC 61000-4-3: 2006 + A1: 2007 + A2: 2010;

IEC 61000-4-4: 2012; IEC 61000-4-5: 2014 + A1: 2017;

IEC 61000-4-6: 2013 + COR1: 2015; IEC 61000-4-8: 2009;

IEC 61000-4-11: 2004 + A1: 2017

# TEST REPORT

Test Report No.: T210708D08-E

Applicant: PERFECTRON CO.,LTD. TAIWAN BRANCH

Address: 2F., No.190, Sec. 2, Zhongxing Rd., Xindian Dist.,  
New Taipei City 231, Taiwan (R.O.C.)

Manufacturer: PERFECTRON CO.,LTD. TAIWAN BRANCH

Address: 2F., No.190, Sec. 2, Zhongxing Rd., Xindian Dist.,  
New Taipei City 231, Taiwan (R.O.C.)

Equipment Under Test (EUT):

Name: Substation Fanless Computer

Brand Name: PERFECTRON CO.,LTD.

Model No.: SCH-3X1

Added Model(s): N/A

## Standards:

|   |   |
|---|---|
| EN 55032: 2015 / A11: 2020<br>CISPR 32: 2015 (Ed 2.0) / C1: 2016                        |   |
| EN IEC 61000-3-2: 2019  | EN 61000-3-3: 2013  |
| EN 55035: 2017 / A11: 2020  |   |
| IEC 61000-4-2: 2008 / EN 61000-4-2: 2009  | IEC 61000-4-6: 2013 + COR1: 2015 /<br>EN 61000-4-6: 2014 + AC: 2015 |
| IEC 61000-4-3: 2006 + A1: 2007 + A2: 2010 /<br>EN 61000-4-3: 2006 + A1: 2008 + A2: 2010 | IEC 61000-4-8: 2009 / EN 61000-4-8: 2010                            |
| IEC 61000-4-4: 2012 / EN 61000-4-4: 2012  | IEC 61000-4-11: 2004 + A1: 2017 /<br>EN 61000-4-11: 2004 + A1: 2017 |
| IEC 61000-4-5: 2014 + A1: 2017 /<br>EN 61000-4-5: 2014 + A1: 2017                       |   |

Date of Sample Receipt : July 8, 2021

Date of Test : July 16, 2021

Date of Issue : August 17, 2021

## Remarks:

This test report can be used for CE and UKCA marking application which is based on equivalent requirements between UK and EU. It is appropriate using designated standards to provide presumption of conformity with GB law.

This report shall not be reproduced except in full, without approval of the Compliance Certification Services Inc. in writing. This document may be altered or revised by Compliance Certification Services Inc. personnel only. The applicant should not use it to claim product endorsement by TAF or any other Government agencies.

## Disclaimer

Variants information between/among model numbers / trademarks is provided by the applicant, test results of this test report are applicable to the sample EUT received of main test model name

Approved By

*Sam Hu*  
Sam Hu ( Assistant Manager)

Date

August 17, 2021



Unless otherwise stated the results shown in this test report refer only to the sample(s) tested and such sample(s) are retained for 90 days only.  
除非另有說明，此報告結果僅對測試之樣品負責，同時此樣品僅保留 90 天。本報告未經本公司書面許可，不可部份複製。

This document is issued by the Company subject to its General Conditions of Service printed overleaf, available on request or accessible at <http://www.sgs.com.tw/Terms-and-Conditions> and, for electronic format documents, subject to Terms and Conditions for Electronic Documents at <http://www.sgs.com.tw/Terms-and-Conditions>. Attention is drawn to the limitation of liability, indemnification and jurisdiction issues defined therein. Any holder of this document is advised that information contained hereon reflects the Company's findings at the time of its intervention only and within the limits of client's instruction, if any. The Company's sole responsibility is to its Client and this document does not exonerate parties to a transaction from exercising all their rights and obligations under the transaction documents. This document cannot be reproduced, except in full, without prior written approval of the Company. Any unauthorized alteration, forgery or falsification of the content or appearance of this document is unlawful and offenders may be prosecuted to the fullest extent of the law.



# **Electromagnetic compatibility (EMC)**

## *-Testing and measurement techniques*

⊙ **IEC 61850-3:**

EMC Pre-Test Result ..... Page 5

⊙ **IEC 61000-4-2:**

Electrostatic discharge immunity test ..... Page 6

⊙ **IEC 61000-4-3:**

Radiated, radio-frequency, electromagnetic field immunity test..... Page 11

⊙ **IEC 61000-4-4:**

Electrical fast transient/burst immunity test ..... Page 14

⊙ **IEC 61000-4-5:**

Surge immunity test ..... Page 15

⊙ **IEC 61000-4-6:**

Immunity to conducted disturbances,  
Induced by radio-frequency fields..... Page 16

⊙ **IEC 61000-4-8:**

Power frequency magnetic field immunity test ..... Page 18

⊙ **IEC 61000-4-11:**

Short interruptions and voltage variations immunity tests ..... Page 19



**Summary of Results**

| Emission   |  |        |
|--|--|--------|
| Standard   | Test Type  | Result |
| EN 55032: 2015 / A11: 2020<br>CISPR 32: 2015 (Ed 2.0) / C1: 2016 | Conducted Emission                                 | PASS   |
|  | ISN  | PASS   |
|  | Radiated Emission                                  | PASS   |
| EN IEC 61000-3-2: 2019   | Harmonic current emissions                         | N/A    |
| EN 61000-3-3: 2013   | Voltage changes,<br>voltage fluctuations & flicker | N/A    |

| Immunity  |           |        |                      |
|---|-----------|--------|----------------------|
| Standard  | Test Type | Result | Performance Criteria |
| IEC 61000-4-2: 2008 /<br>EN 61000-4-2: 2009   | ESD       | PASS   | B                    |
| IEC 61000-4-3: 2006 + A1: 2007 + A2: 2010 /<br>EN 61000-4-3: 2006 + A1: 2008 + A2: 2010 | RS        | PASS   | A                    |
| IEC 61000-4-4: 2012 /<br>EN 61000-4-4: 2012   | EFT       | PASS   | B                    |
| IEC 61000-4-5: 2014 + A1: 2017 /<br>EN 61000-4-5: 2014 + A1: 2017                       | Surge     | PASS   | B                    |
| IEC 61000-4-6: 2013 + COR1: 2015 /<br>EN 61000-4-6: 2014 + AC: 2015                     | CS        | PASS   | A                    |
| IEC 61000-4-8: 2009 /<br>EN 61000-4-8: 2010   | PFMF      | N/A    | A                    |
| IEC 61000-4-11: 2004 + A1: 2017 /<br>EN 61000-4-11: 2004 + A1: 2017                     | DIP       | N/A    | C/C/B                |

**Reporting Statements of Conformity**

The conformity statement in this report is based solely on the test results, measurement uncertainty is excluded.

**Deviation**

No deviation from the mentioned test methods and applicable standards.





## Test of IEC/EN 61000-4-2

### Test Instruments

| Immunity Shielded Room |              |              |               |                  |                 |
|------------------------|--------------|--------------|---------------|------------------|-----------------|
| EQUIPMENT TYPE         | Manufacturer | Model Number | Serial Number | Calibration Date | Calibration Due |
| Aneroid Barometer      | SATO         | 7610-20      | 89090         | 09/01/2020       | 08/31/2021      |
| ESD Simulator          | Teseq        | NSG 437      | 1189          | 04/19/2021       | 04/18/2022      |
| Thermo-Hygro Meter     | Wisewind     | 201A         | SD-S039       | 01/06/2021       | 01/05/2022      |

Testing Site : No.163-1, Jhongsheng Rd., Xindian Dist., New Taipei City, Taiwan

### EUT Operating Condition

Environment:

|             |          |              |
|-------------|----------|--------------|
| Temperature | Humidity | Air Pressure |
| 22 °C       | 46 %RH   | 1001 hpa     |




ESD Test point

Front



Back

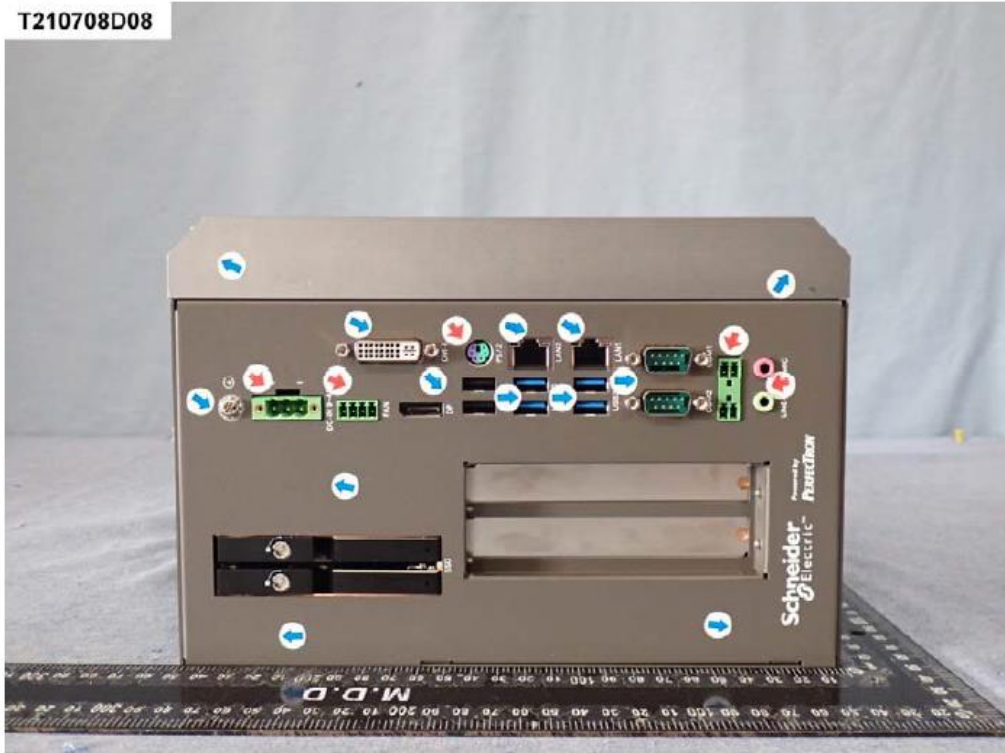


Air Discharge: ↑  
Contact Discharge: ↑






Left

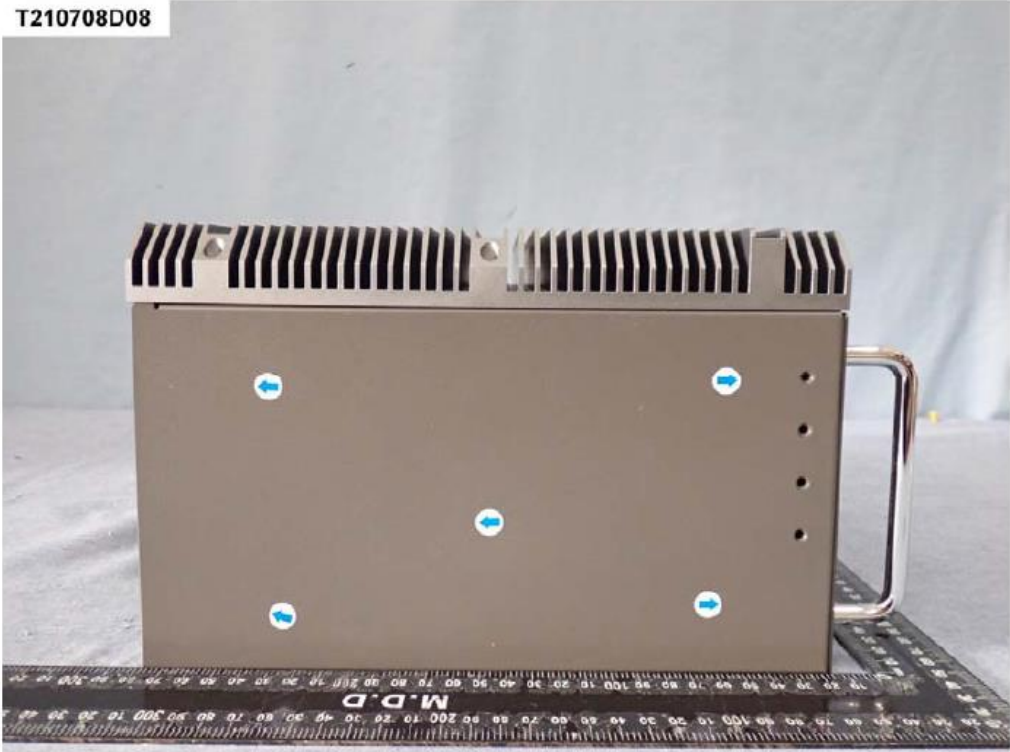


Right

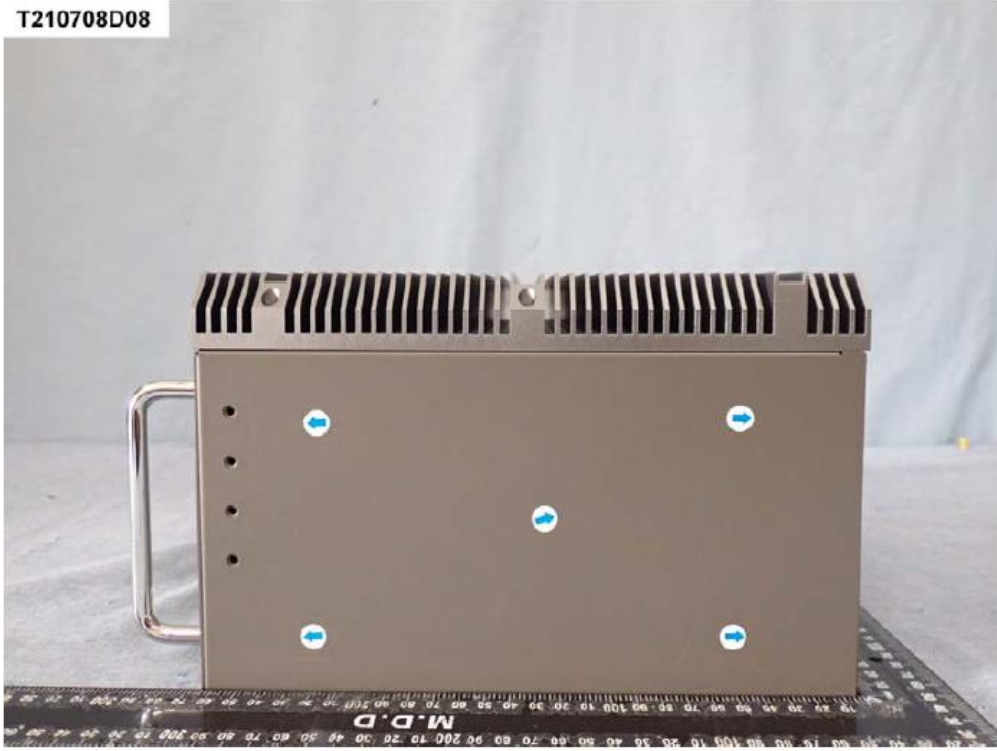

Air Discharge: ↑  
Contact Discharge: ↑

Top

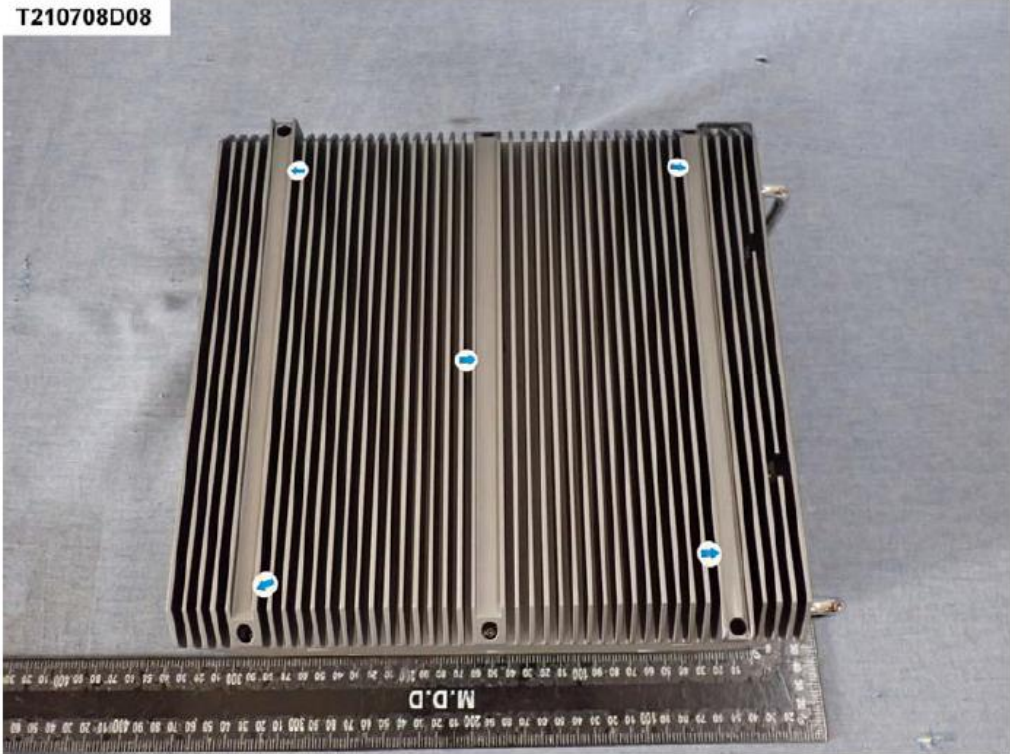

Air Discharge: ↑  
Contact Discharge: ↑



**Test of IEC/EN 61000-4-3**

**Test Instruments**

| 844 RS Chamber  |                      |              |               |                  |                 |
|---|----------------------|--------------|---------------|------------------|-----------------|
| EQUIPMENT TYPE  | Manufacturer         | Model Number | Serial Number | Calibration Date | Calibration Due |
| Electric Field Probe  | AR                   | FL7006       | 0356656       | 10/14/2020       | 10/13/2021      |
| Field of Calibration  | CCS                  | Chamber#RS   | 80-1000MHz    | 02/26/2021       | 02/25/2022      |
| RF Power Meter  | Boonton              | 4242         | 17419         | 03/17/2021       | 03/16/2022      |
| Power Sensor  | Boonton              | 51011A-EMC   | 36833         | 03/17/2021       | 03/16/2022      |
| Power Sensor  | Boonton              | 51011A-EMC   | 36834         | 03/17/2021       | 03/16/2022      |
| Signal Generator  | Agilent              | N5181A       | MY47421336    | 11/15/2020       | 11/14/2021      |
| Thermo-Hygro Meter  | Wisewind             | N/A          | SD-S019       | 10/19/2020       | 10/18/2021      |
| Broadband Antenna   | Schwarzbeck          | VUSLP 9111E  | D-69250       | N.C.R            | N.C.R           |
| Power Amplifier   | Milmega              | 80RF1000-600 | 1079361       | N.C.R            | N.C.R           |
| Field of Calibration  | CCS                  | Chamber#RS   | 1000-6000M    | 02/25/2021       | 02/24/2022      |
| Direction Coupler   | AR                   | DC7144A      | 306217        | N.C.R            | N.C.R           |
| Microwave Antenna   | Schwarzbeck          | STLP 9149    | 767           | N.C.R            | N.C.R           |
| Power Amplifier   | AR                   | 60S1G3       | 302728        | N.C.R            | N.C.R           |
| Power Amplifier   | Milmega              | AS1860-100   | 1075832       | N.C.R            | N.C.R           |
| Power Amplifier   | Teseq                | CBA6G-100D   | 1087370       | N.C.R            | N.C.R           |
| Test Software   | EmcwareVer. 2.6.0.16 |              |               |                  |                 |
| Testing Site : No.163-1, Jhongsheng Rd., Xindian Dist., New Taipei City, Taiwan |                      |              |               |                  |                 |

**EUT Operating Condition**

Environment:

| Temperature | Humidity | Air Pressure |
|-------------|----------|--------------|
| 24 °C       | 48 %RH   | 1001 hpa     |



## Results of Radiated Radio Frequency Electromagnetic (RS)

Model No. : SCH-3X1  
 Tested By : Lion Lee  
 Tested Date : July 16, 2021  
 Test Mode : Mode 1  
 Basic Standard : IEC/EN 61000-4-3  
 Frequency range : 80 MHz - 1000 MHz  
 Frequency range : 1800 MHz, 2600 MHz, 3500 MHz, 5000 MHz ( $\pm 1\%$ )  
 Field strength : 3 V/m  
 Modulation : 80% AM (1kHz)  
 Frequency step : 1 % of fundamental  
 Polarity of Antenna : Horizontal and Vertical  
 Dwell Time : 3 seconds  
 Test distance : 3 m

| No. | Frequency (MHz) | Antenna Orientation | Observation | EUT Orientation |
|-----|-----------------|---------------------|-------------|-----------------|
| 1   | 80 - 1000       | Vertical/Horizontal | A           | 0 degree        |
| 2   | 80 - 1000       | Vertical/Horizontal | A           | 90 degree       |
| 3   | 80 - 1000       | Vertical/Horizontal | A           | 180 degree      |
| 4   | 80 - 1000       | Vertical/Horizontal | A           | 270 degree      |

**Remark:** A: No degradation of performance or loss of function.

| No. | Frequency (MHz)                      | Antenna Orientation | Observation | EUT Orientation |
|-----|--------------------------------------|---------------------|-------------|-----------------|
| 1   | 1800, 2600, 3500, 5000 ( $\pm 1\%$ ) | Vertical/Horizontal | A           | 0 degree        |
| 2   | 1800, 2600, 3500, 5000 ( $\pm 1\%$ ) | Vertical/Horizontal | A           | 90 degree       |
| 3   | 1800, 2600, 3500, 5000 ( $\pm 1\%$ ) | Vertical/Horizontal | A           | 180 degree      |
| 4   | 1800, 2600, 3500, 5000 ( $\pm 1\%$ ) | Vertical/Horizontal | A           | 270 degree      |

**Remark:** A: No degradation of performance or loss of function.



Model No. : SCH-3X1  
 Tested By : Lion Lee  
 Tested Date : July 16, 2021  
 Test Mode : Mode 1 (Audio Mode)  
 Basic Standard : IEC/EN 61000-4-3  
 Frequency range : 80 MHz - 1000 MHz  
 Frequency range : 1800 MHz, 2600 MHz, 3500 MHz, 5000 MHz ( $\pm 1\%$ )  
 Field strength : 3 V/m  
 Modulation : 80% AM (1kHz)  
 Frequency step : 1 % of fundamental  
 Polarity of Antenna : Horizontal and Vertical  
 Dwell Time : 3 seconds  
 Test distance : 3 m

| No. | Frequency (MHz) | Antenna Orientation | Observation | EUT Orientation |
|-----|-----------------|---------------------|-------------|-----------------|
| 1   | 80 - 1000       | Vertical/Horizontal | A           | 0 degree        |
| 2   | 80 - 1000       | Vertical/Horizontal | A           | 90 degree       |
| 3   | 80 - 1000       | Vertical/Horizontal | A           | 180 degree      |
| 4   | 80 - 1000       | Vertical/Horizontal | A           | 270 degree      |

**Remark:** A: No degradation of performance or loss of function.

| No. | Frequency (MHz)                      | Antenna Orientation | Observation | EUT Orientation |
|-----|--------------------------------------|---------------------|-------------|-----------------|
| 1   | 1800, 2600, 3500, 5000 ( $\pm 1\%$ ) | Vertical/Horizontal | A           | 0 degree        |
| 2   | 1800, 2600, 3500, 5000 ( $\pm 1\%$ ) | Vertical/Horizontal | A           | 90 degree       |
| 3   | 1800, 2600, 3500, 5000 ( $\pm 1\%$ ) | Vertical/Horizontal | A           | 180 degree      |
| 4   | 1800, 2600, 3500, 5000 ( $\pm 1\%$ ) | Vertical/Horizontal | A           | 270 degree      |

**Remark:** A: No degradation of performance or loss of function.





**Test of IEC/EN 61000-4-4**

**Test Instruments**

| Immunity Shield Room  |                    |              |               |                  |                 |
|---|--------------------|--------------|---------------|------------------|-----------------|
| EQUIPMENT TYPE  | Manufacturer       | Model Number | Serial Number | Calibration Date | Calibration Due |
| Capacitive Clamp  | EMC-Partner        | CN-EFT1000   | 589           | 06/07/2021       | 06/06/2022      |
| EMC Test System   | Teseq              | NSG 3060     | 1718          | 12/15/2020       | 12/14/2021      |
| Test Software   | WIN 3000Ver. 1.3.2 |              |               |                  |                 |
| Testing Site : No.163-1, Jhongsheng Rd., Xindian Dist., New Taipei City, Taiwan |                    |              |               |                  |                 |

**EUT Operating Condition**

Environment:

|             |          |              |
|-------------|----------|--------------|
| Temperature | Humidity | Air Pressure |
| 22 °C       | 46 %RH   | 1001 hpa     |

**Results of Electrical Fast Transient (EFT)**

Model No. : SCH-3X1  
 Tested By : Lion Lee  
 Tested Date : July 16, 2021  
 Test Mode : Mode 1  
 Basic Standard : IEC/EN 61000-4-4  
 Test Voltage : DC Input: ± 0.5 kV  
 Signal/Comm. : ± 0.5 kV  
 Polarity : Positive/Negative  
 Impulse Frequency : 5 kHz  
 Tr/Th : 5/50ns  
 Burst : 15ms/300ms

**Observation:**

| Test Point   | Polarity | Test Level (kV) | Results |
|--------------|----------|-----------------|---------|
| L            | +/-      | 0.5             | A       |
| N            | +/-      | 0.5             | A       |
| PE           | +/-      | 0.5             | A       |
| L-N          | +/-      | 0.5             | A       |
| L-PE         | +/-      | 0.5             | A       |
| N-PE         | +/-      | 0.5             | A       |
| L-N-PE       | +/-      | 0.5             | A       |
| Signal/Comm. | +/-      | 0.5             | A       |

**Remark:** A: No degradation of performance or loss of function



**Test of IEC/EN 61000-4-5**

**Test Instruments**

| Immunity Shield Room  |                    |              |               |                  |                 |
|---|--------------------|--------------|---------------|------------------|-----------------|
| EQUIPMENT TYPE  | Manufacturer       | Model Number | Serial Number | Calibration Date | Calibration Due |
| CDN   | EMC-Partner        | CDN-UTP8     | 1505          | 12/15/2020       | 12/14/2021      |
| EMC Test System   | Teseq              | NSG 3060     | 1718          | 12/15/2020       | 12/14/2021      |
| Test Software   | WIN 3000Ver. 1.3.2 |              |               |                  |                 |
| Testing Site : No.163-1, Jhongsheng Rd., Xindian Dist., New Taipei City, Taiwan |                    |              |               |                  |                 |

**EUT Operating Condition**

Environment:

| Temperature | Humidity | Air Pressure |
|-------------|----------|--------------|
| 22 °C       | 46 %RH   | 1001 hpa     |

**Results of Surge Test**

Model No. : SCH-3X1  
 Tested By : Lion Lee  
 Tested Date : July 16, 2021  
 Test Mode : Mode 1  
 Basic Standard : IEC/EN 61000-4-5  
 Test Rate : 1 pulse every minute  
 No. of Tests : 5 positive and 5 negative pulses  
 Waveform : 1.2/50µs (8/20µs)

**Observation Description**

DC input line:

| Test Point | Phase Angle (degree)    | Polarity (+/-) | Test Level (kV) | Observation |
|------------|-------------------------|----------------|-----------------|-------------|
| DC input   | No phase angle (degree) | +/-            | 0.5             | A           |

**Remark:** A: No degradation of performance or loss of function.

Signal line:

Test Rate : 1 pulse every minute  
 No. of Tests : 5 positive and 5 negative pulses  
 Waveform : 10/700µs

**Observation Description**

Signal line:

| Test Point | Phase Angle (degree)    | Polarity (+/-) | Test Level (kV) | Observation |
|------------|-------------------------|----------------|-----------------|-------------|
| Signal I/O | No phase angle (degree) | +/-            | 1               | A           |

**Remark:** A: No degradation of performance or loss of function.



**Test of IEC/EN 61000-4-6**

**Test Instruments**

| CS Room   |                                 |                |               |                  |                 |
|---|---------------------------------|----------------|---------------|------------------|-----------------|
| EQUIPMENT TYPE  | Manufacturer                    | Model Number   | Serial Number | Calibration Date | Calibration Due |
| CDN   | Teseq                           | CDN S751A      | 46649         | 11/16/2020       | 11/15/2021      |
| CDN   | Teseq                           | CDN M016       | 35821         | 11/16/2020       | 11/15/2021      |
| CDN   | TESEQ                           | CDN T400A      | 28547         | 11/16/2020       | 11/15/2021      |
| CDN   | FCC                             | FCC-801-M3-25A | 9973          | 11/16/2020       | 11/15/2021      |
| CDN   | Teseq                           | CDN T8A-10     | 57182         | 05/26/2021       | 05/25/2022      |
| Compact Immunity Test System  | TESEQ                           | NSG 4070       | 39581         | 11/20/2020       | 11/19/2021      |
| Test Software   | NSG 4070 Control Program V1.2.0 |                |               |                  |                 |
| Testing Site : No.163-1, Jhongsheng Rd., Xindian Dist., New Taipei City, Taiwan |                                 |                |               |                  |                 |

**EUT Operating Condition**

Environment:

| Temperature | Humidity | Air Pressure |
|-------------|----------|--------------|
| 25 °C       | 50 %RH   | 1001 hpa     |

**Results of Immunity to Conducted Disturbances (CS)**

Model No. : SCH-3X1  
 Tested By : Lion Lee  
 Tested Date : July 16, 2021  
 Test Mode : Mode 1  
 Basic Standard : IEC/EN 61000-4-6  
 Frequency range : 0.15 MHz -10 MHz  
 Field strength : 3 Vrms  
 Frequency range : 10 MHz - 30 MHz  
 Field strength : 3 V to 1Vrms  
 Frequency range : 30 MHz - 80 MHz  
 Field strength : 1 Vrms  
 Modulation : 80% AM, 1 kHz Sinewave  
 Frequency step : 1 % of fundamental  
 Dwell Time : 3 seconds  
 Coupling Method : CDN-M2, CDN-T8

| Cable Description | Frequency (MHz) | Observation |
|-------------------|-----------------|-------------|
| DC input          | 0.15 – 80       | A           |

Signal Ports

| Cable Description | Frequency (MHz) | Observation |
|-------------------|-----------------|-------------|
| Signal/Comm.      | 0.15 – 80       | A           |

**Remark:** A: No degradation of performance or loss of function.



Model No. : SCH-3X1  
 Tested By : Lion Lee  
 Tested Date : July 16, 2021  
 Test Mode : Mode 1 (Audio Mode)  
 Basic Standard : IEC/EN 61000-4-6  
 Frequency range : 0.15 MHz -10 MHz  
 Field strength : 3 Vrms  
 Frequency range : 10 MHz - 30 MHz  
 Field strength : 3 V to 1Vrms  
 Frequency range : 30 MHz - 80 MHz  
 Field strength : 1 Vrms  
 Modulation : 80% AM, 1 kHz Sinewave  
 Frequency step : 1 % of fundamental  
 Dwell Time : 3 seconds  
 Coupling Method : CDN-M2, CDN-T8

| Cable Description | Frequency (MHz) | Observation |
|-------------------|-----------------|-------------|
| DC input          | 0.15 – 80       | A           |

#### Signal Ports

| Cable Description | Frequency (MHz) | Observation |
|-------------------|-----------------|-------------|
| Signal/Comm.      | 0.15 – 80       | A           |

**Remark:** A: No degradation of performance or loss of function.



**Test of IEC/EN 61000-4-8**

**Test Instruments**

| Immunity Shield Room  |              |              |               |                  |                 |
|---|--------------|--------------|---------------|------------------|-----------------|
| EQUIPMENT TYPE  | Manufacturer | Model Number | Serial Number | Calibration Date | Calibration Due |
|   |              |              |               |                  |                 |
| Testing Site : No.163-1, Jhongsheng Rd., Xindian Dist., New Taipei City, Taiwan |              |              |               |                  |                 |

**EUT Operating Condition**

Environment:

| Temperature | Humidity | Air Pressure |
|-------------|----------|--------------|
| N/A         | N/A      | N/A          |

**Result of Immunity to Power Frequency Magnetic Field**

Model No. : SCH-3X1  
 Tested By : N/A  
 Tested Date : N/A  
 Test Mode : N/A  
 Basic Standard : IEC/EN 61000-4-8  
 Power Frequency : 50 Hz  
 Magnetic Field : 1 A/m(r.m.s)  
 Coil Orientation : X, Y, Z Axis  
 Observation : N/A

**Remark:** N/A: There is no any sensitive part for magnetic field test. Applicable only to equipment containing susceptible to magnetic field.





**Test of IEC/EN 61000-4-11**

**Test Instruments**

| Immunity Shielded Room  |              |              |               |                  |                 |
|---|--------------|--------------|---------------|------------------|-----------------|
| EQUIPMENT TYPE  | Manufacturer | Model Number | Serial Number | Calibration Date | Calibration Due |
|   |              |              |               |                  |                 |
|   |              |              |               |                  |                 |
| Testing Site : No.163-1, Jhongsheng Rd., Xindian Dist., New Taipei City, Taiwan |              |              |               |                  |                 |

**EUT Operating Condition**

Environment:

| Temperature | Humidity | Air Pressure |
|-------------|----------|--------------|
| N/A         | N/A      | N/A          |

**Results of Voltage Dips Immunity Test**

Model No. : SCH-3X1  
 Tested By : N/A  
 Tested Date : N/A  
 Test Mode : N/A  
 Basic Standard : IEC 61000-4-11  
 EUT Rated Voltage : 230 Volts.  
 Reduction Voltage : 30, >95 % Ut  
 Phase Angle : 0,180 degree  
 Total events : 3 dropouts  
 Event interval : 10 seconds

| Test Power: 230Vac, 50Hz |                                  |  |             |
|--------------------------|----------------------------------|--|-------------|
| Environmental phenomena  | Test specification (% reduction) | Duration (in periods of the rated frequency) | Observation |
| Voltage Interruptions    | >95                              | 250  | N/A         |
| Voltage dips             | >95                              | 0.5  | N/A         |
|                          | 30                               | 25   | N/A         |

| Test Power: 230Vac, 60Hz |                                  |  |             |
|--------------------------|----------------------------------|--|-------------|
| Environmental phenomena  | Test specification (% reduction) | Duration (in periods of the rated frequency) | Observation |
| Voltage Interruptions    | >95                              | 300  | N/A         |
| Voltage dips             | 30                               | 30   | N/A         |

**Remark:** N/A: The subject equipment is not intended to be connected to AC mains supply. Therefore, this test is not applicable.